

ADDENDUM #1

COMPETITIVE BID #WG20-39 – Purchase and Installation of One (1) New 300 kW Generator and One (1) New 400 AMP Automatic Transfer Switch for the Baldwin County Revenue Commission Building located in Bay Minette, Alabama

This addendum consists of following change:

Bid Specification
Should Read:

Remove feed from Alabama Power Company Transformer to 300 AMP main breaker located in electrical room, return all wire back to owner. Approximately 100 ft.

New feed to 300 AMP panel, will be from 400 AMP main breaker which has existing double lugs. This 400 AMP panel is in the electrical room next to 300 AMP panel.

See attached drawing

Done this 16th day of July, 2020.




BILLIE JO UNDERWOOD, Chairman
Baldwin County Commission

ADDENDUM # 1

ELECTRICAL FOR 300 K.W. GENERATOR
REVENUE Bldg. BAY MINETTE, AL.

CONTACT :
JUNNIS LONG
251-295-3133

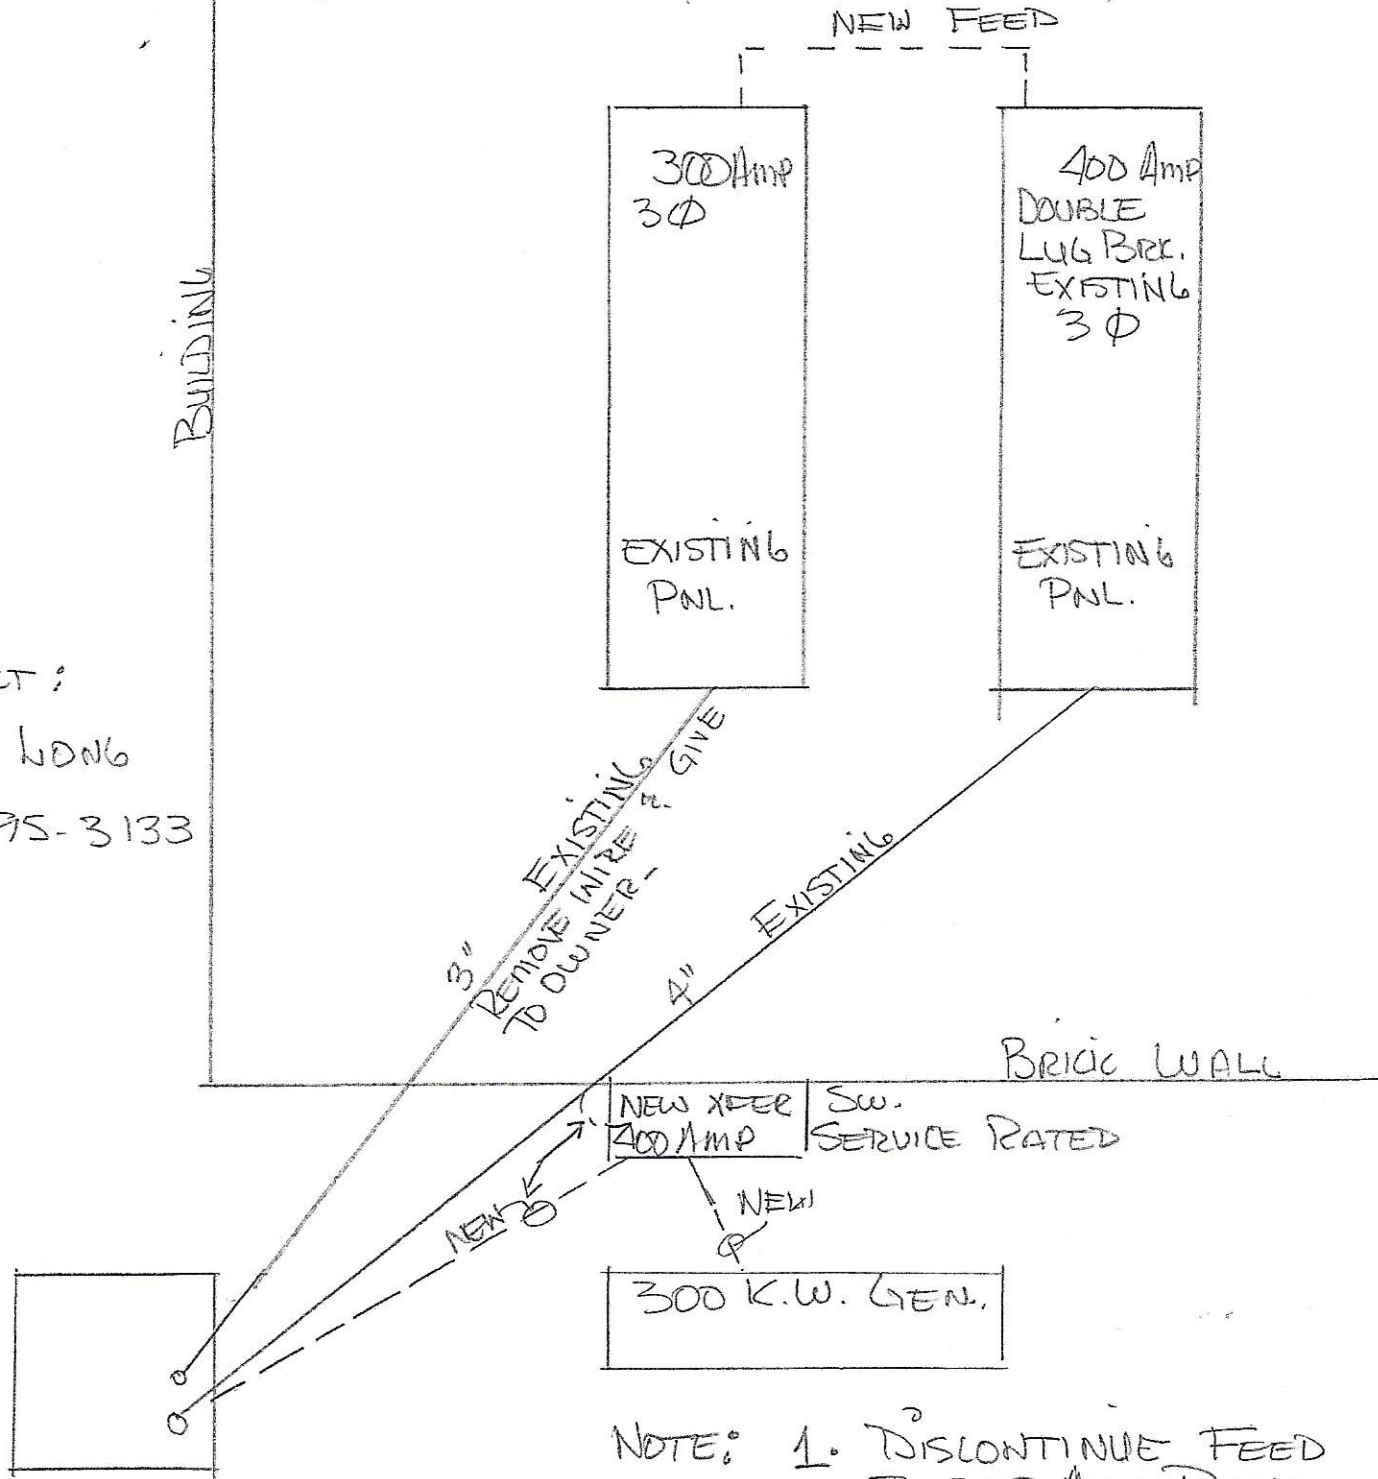

NOTE: 1. DISCONTINUE FEED
TO 300 Amp PANEL.
2. FEED 300 Amp PANEL
FROM 400 Amp BREAKER
THAT IS EXISTING